

User manual 18 re-connect Stat-X® fire extinguisher



The installation of a fire extinguishing system must be performed professionally by a competent specialist with the necessary skills and expertise using the correct tools and following the proper work procedures and practices. This information sheet concerns the connection of the electrically activated extinguisher unit.

1. For the connection between the Stat-X fire extinguisher and the activation electronics, use the existing cable and the supplied connector. (See photo 1)
2. Strip cable jacket from the end of the existing cable, connected to the fire extinguisher, again and finish the two wires with insulated crimp bootlace ferrules. (See photo 4)
3. Mount the supplied connector. (See photo 5 & 6)
4. Connect the connector to the Stat-X fire extinguisher. (See photo 2 & 3)
5. Check the connection and measure the resistance from the other end of the cable. It should be between 1.4 and 2 ohms. (See photo 7)
6. After conducting the point 5 checks, reconnect the cable to the existing control electronics.

Photo 1

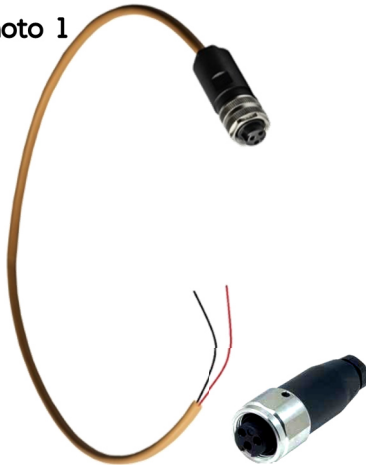


Photo 2



Photo 3



Photo 4

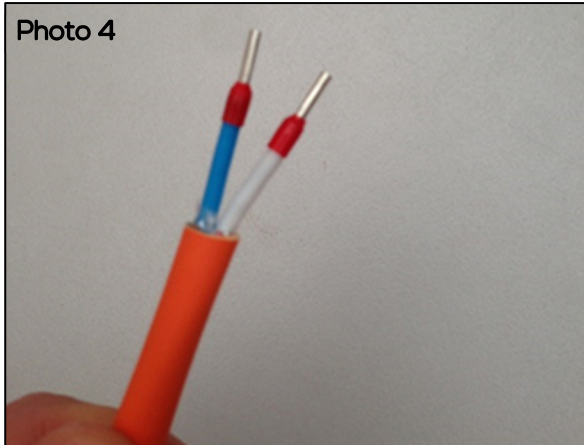


Photo 5



Photo 6

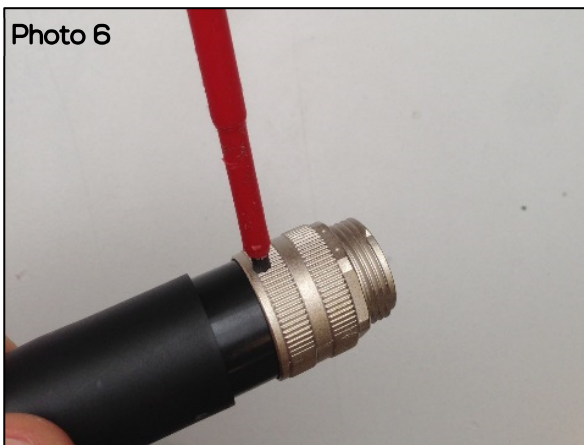


Photo 7



K & G Groep B.V. Spoordijkhof 1 4944 AZ Raamsdonk Netherlands

No part of this publication may be reproduced, stored in an automated database, or made public in any form or by any means either electronically, mechanically or by photocopying, recording, or in any other way, without prior written permission from K&G Groep BV